S-25 DUPLEX

S.C.C.R 5000A

SUNBELT™ POWER CONTROLS
1625 Wallace Dr, Ste 110
Carrollton, Texas 75006
(972) 620-2950
info@sunbeltpowercontrols.com
sunbeltpowercontrols.com

DATE 12/13/07 HP.

DRAWING# S2131HWSFHPET VOLT.

DRAWN BY RAK PHASE 1

SERIAL # FLA

NOTE: USE COPPER, 60 C RATED WIRE FOR LESS THAN 100A. USE COPPER, 75 C RATED WIRE FOR 100A OR MORE.

CAUTION:
AN N.E.C. APPROVED BRANCH CIRCUIT PROTECTIVE DEVICE MUST BE INSTALLED AHEAD OF THIS CONTROL PANEL IN ACCORDANCE WITH THE N.E.C.

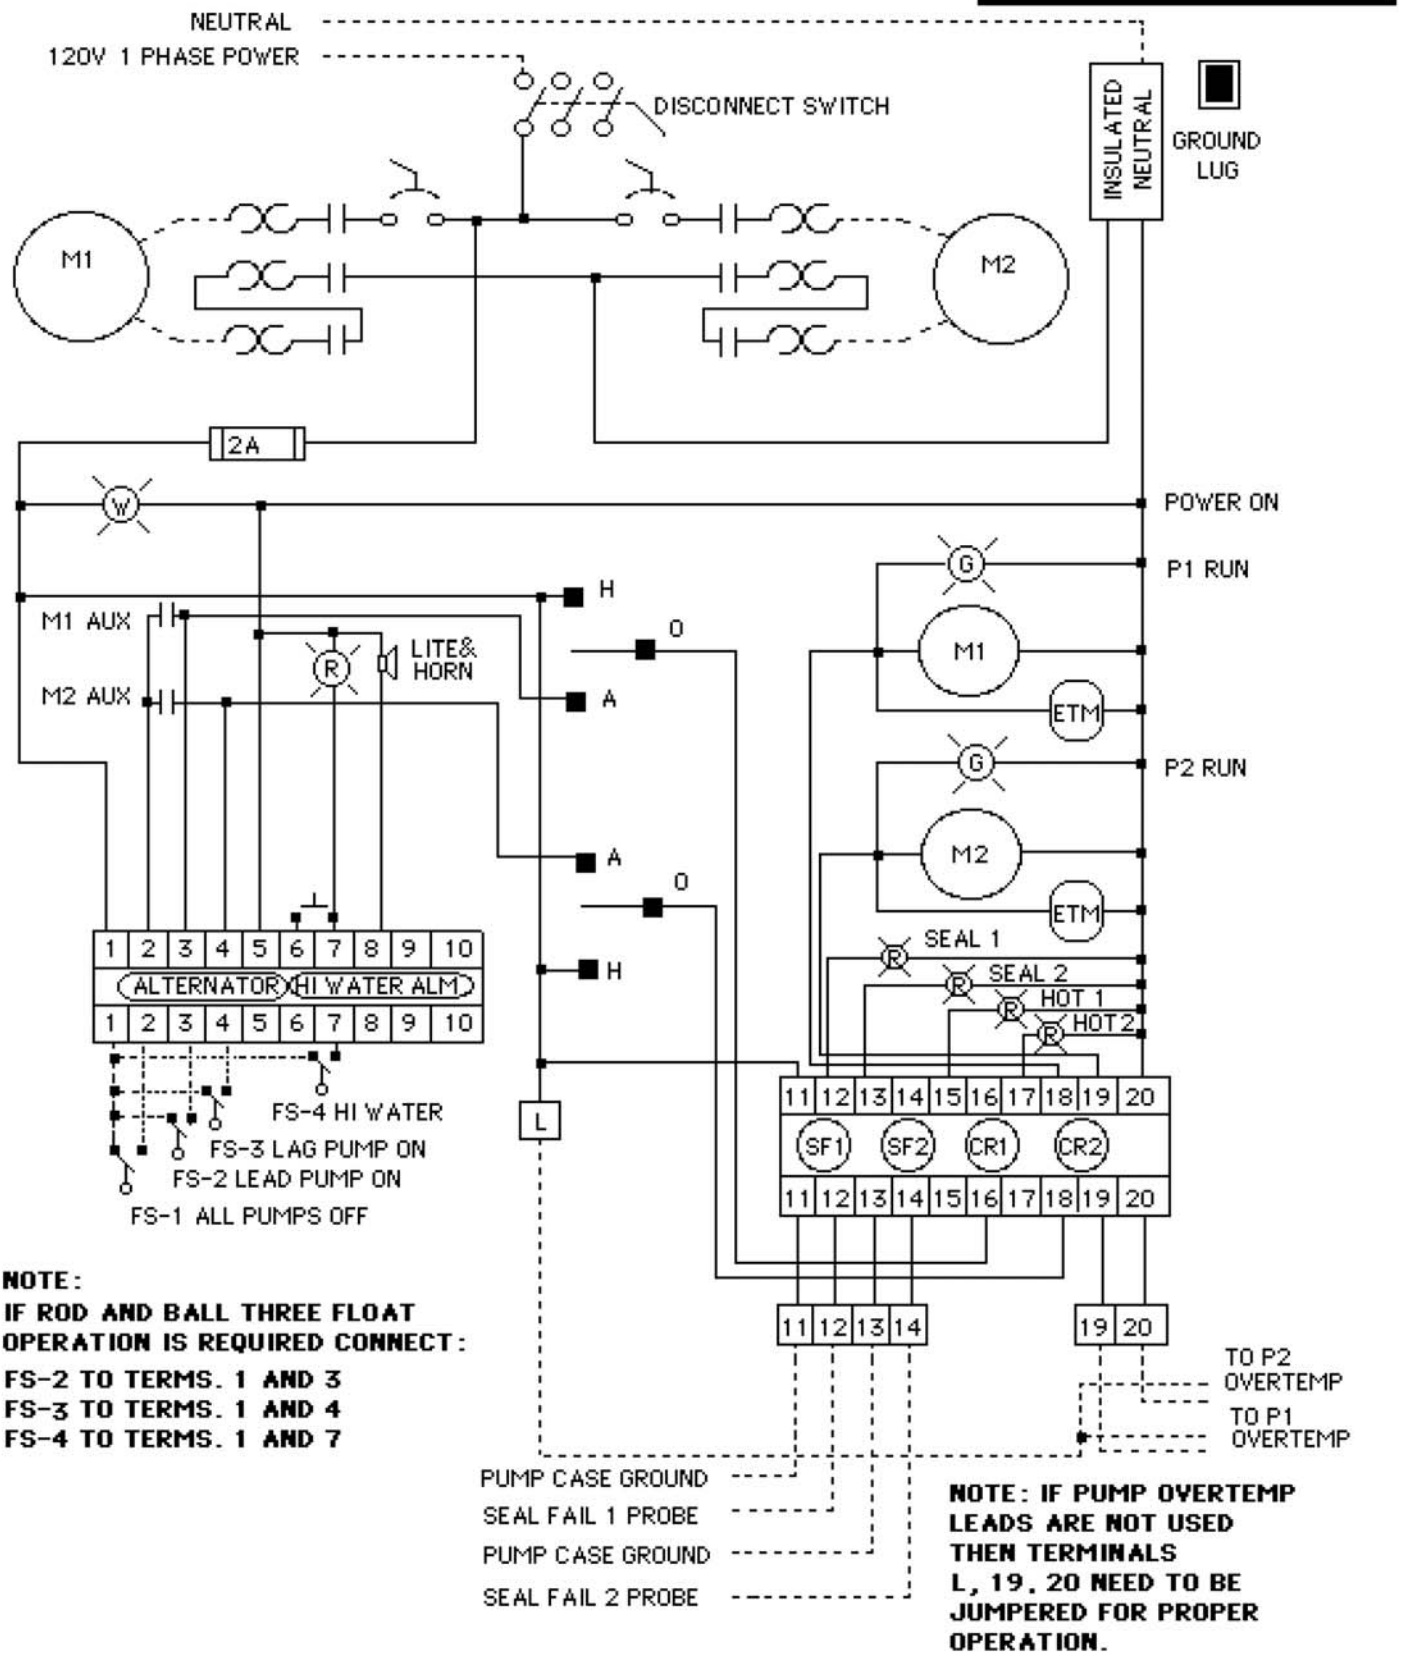

NOTE:
IF ROD AND BALL THREE FLOAT OPERATION IS REQUIRED CONNECT:

FS-2 TO TERMS. 1 AND 3
FS-3 TO TERMS. 1 AND 4
FS-4 TO TERMS. 1 AND 7

NOTE: IF PUMP OVERTEMP LEADS ARE NOT USED THEN TERMINALS L, 19, 20 NEED TO BE JUMPERED FOR PROPER OPERATION.